




PROGRESSIVE DESIGN COLLABORATIVE, LTD.

ADDENDUM NO. 1A

ADDENDUM DATE: February 1, 2012
PROJECT: DOBBS SCHOOL UPGRADES VOCATIONAL BUILDING
OWNER: NC DJJDP
PROJECT NO. PDC Project #10053
ENGINEER: Progressive Design Collaborative, Ltd.

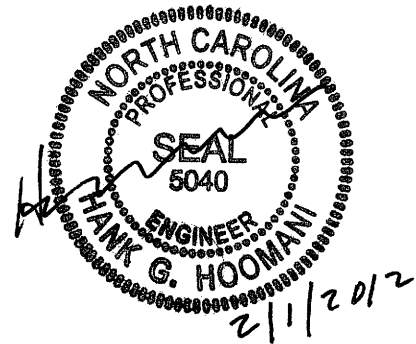

This Addendum, applicable to the work designed below, shall be understood to be and is an addendum and shall be part of and included in the contract for the above referenced project.

GENERAL:

- 1. On January 30, 2012 a Pre-Bid Meeting was held at the school site. The following people were present at this meeting:

Table with 4 columns: Name, Company, Tel. No., Email Address / Fax No. containing contact information for various attendees.


David Mills	DJJDP	919-538-9987	david.mills@djjdp.nc.gov
Preston Davis	DJJDP	252-229-1875	preston.davis@djjdp.nc.gov
Robert Carmac	Smith Sinnett Architecture	919-781-8582	rcarmac@smithsinnett.com
Hank G. Hoomani	PDC	919-790-9989	hank@pdcengineers.com
John Tomaszewski	PDC	919-790-9989	john@pdcengineers.com

2. The following items were discussed:

- a. The project Bid opening will be on February 9, 2012 at the Dobbs School – Administration Building – Conference Room at 3:00 pm. This is a change from the location stated in the specifications.
- b. Contractors shall provide port-a-john for the duration of construction.
- c. Due to the type of students living on this campus, the contractors are prohibited from engaging in conversation or other activities with the students.
- d. General Contractor shall provide all cutting and patching as required for the completion of this project.
- e. General Contractor shall provide the fencing required for the new heat pump condensor where indicated in the attached sketch.
- f. Owner shall purchase the kitchen equipment as specified on these plans. The kitchen equipment supplier shall unpack all kitchen equipment and deliver it to the project site. G.C. will be responsible for locating the kitchen equipment where shown on the plans. The mechanical contractor will be responsible for installing the kitchen hood and all associated ducts, fans, etc.
- g. The General Contractor shall remove all ceiling tiles and the ceiling grid from Room 120 (this is the room between the Industrial Arts room and the new Teaching Kitchen and its new storage room) in order for the Mechanical Contractor to complete their ductwork installation. After the completion of the ductwork, the G.C. shall re-install the ceiling grid and ceiling tiles. The Electrical Contractor shall remove the existing lights. After the ceiling grid is installed, the E.C. shall install the existing light fixtures unless Alternate E-2 is accepted at which time the new light fixtures shall be installed.
- h. Contractors shall be responsible for the security of their tools and tool box.
- i. Contractors shall keep their cars, trucks locked at all times.
- j. The new fire alarm system in the Vocational Building shall be a stand alone. This system shall be monitored via a dialer.
- k. Clarification to fire alarm and plumbing RFIs will be sent out on Addendum #2.

END OF ADDENDUM NO. 1A

Attachments – Sketch (1)

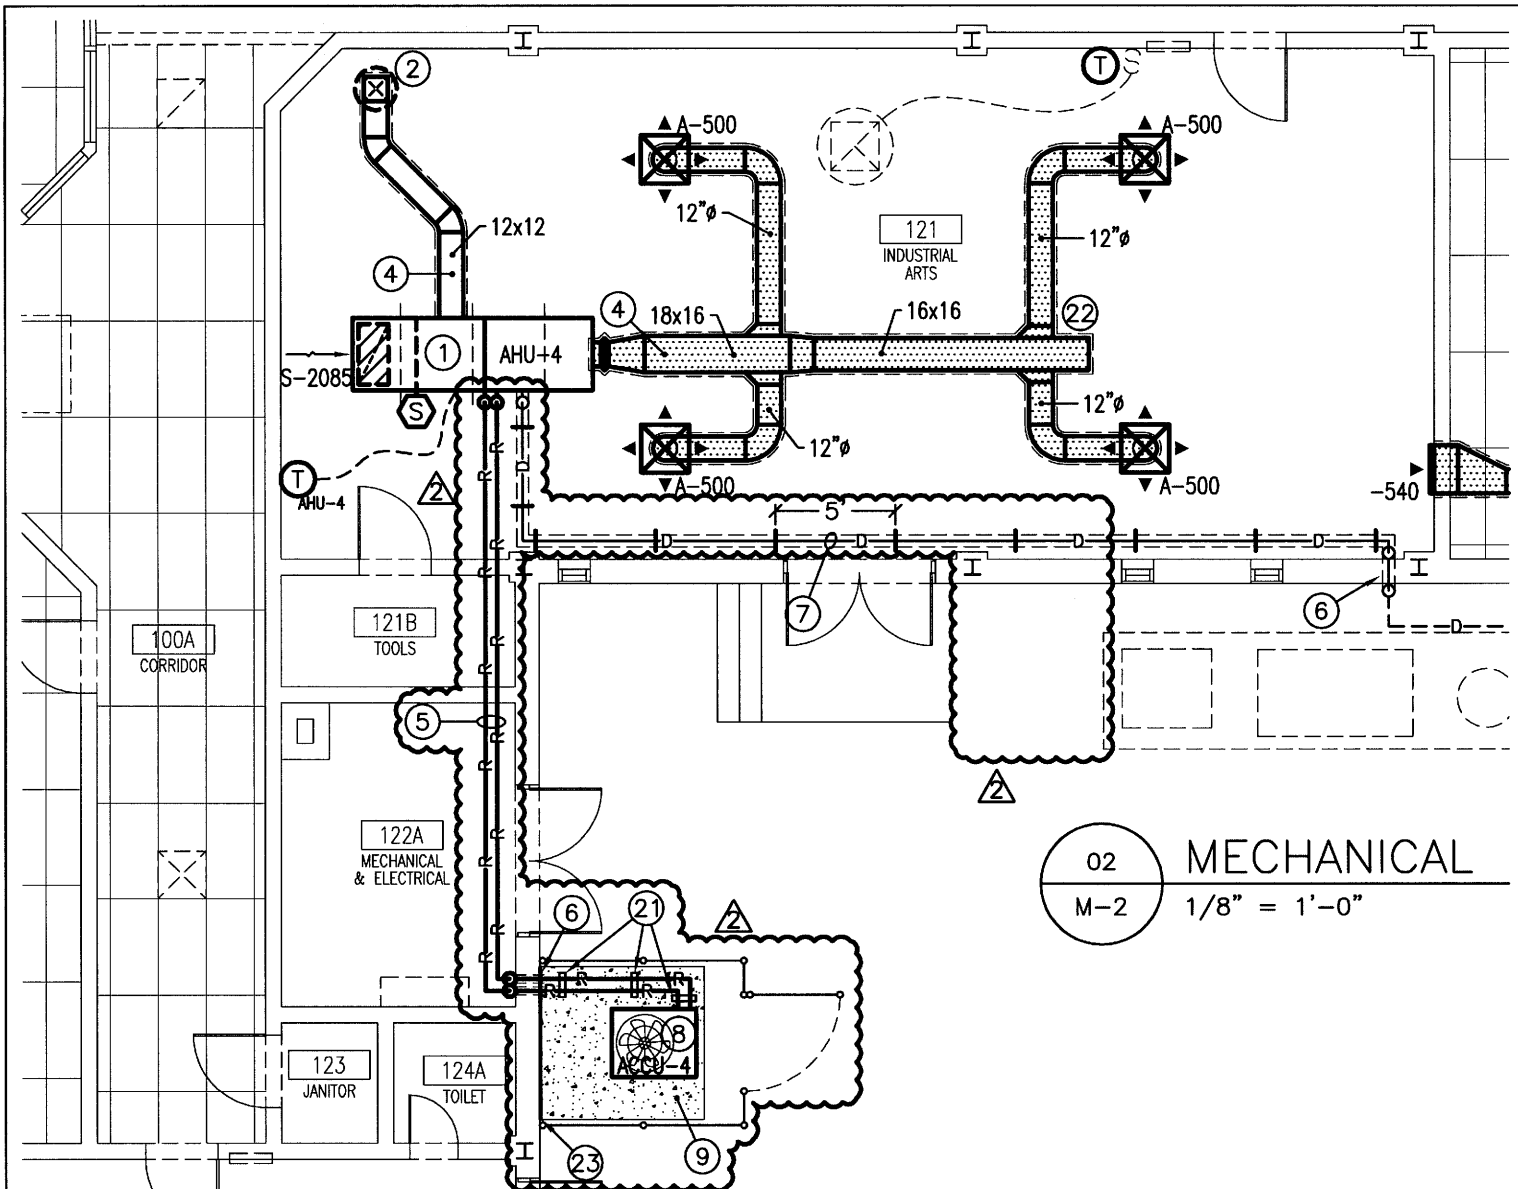

02 MECHANICAL
M-2 1/8" = 1'-0"

- ②② EXTEND SUPPLY AIR DUCTWORK x 1 1/2 WIDTH OF LARGEST TAP-OFF TO CREATE "CUSHIONHEAD" FOR MAXIMIZATION OF AIR FLOW WITH A MINIMAL FRICTION LOSS. SEE "CUSHIONHEAD" DETAIL M1/02.
- ②③ EXPANSION JOINT MATERIAL.

THIS SKETCH IS TAKEN FROM SHEET M-2 OF THE PROJECT DRAWINGS.



2900 Rowland Road, Suite 100
Raleigh, N.C. 27615
Phone: 919-790-9989
Fax: 919-790-9367
Email: pdc@pdcengineers.com
License No. C-0183

HVAC renovations
Dobbs Vocational School
Addendum: M1A
Sketch: 1 of 1

February 1, 2012
10053
AD-M1A-01